



THURSTON COUNTY  
WASHINGTON  
SINCE 1852

## Thurston County Development Services


2000 Lakeridge Dr SW; Olympia, WA 98502

Phone: (360) 786-5490; TDD: (360) 754-2933

FAX (360) 754-2939

Website: [www.co.thurston.wa.us/permitting](http://www.co.thurston.wa.us/permitting)

# TC Figure 15 Propane Tank Setbacks

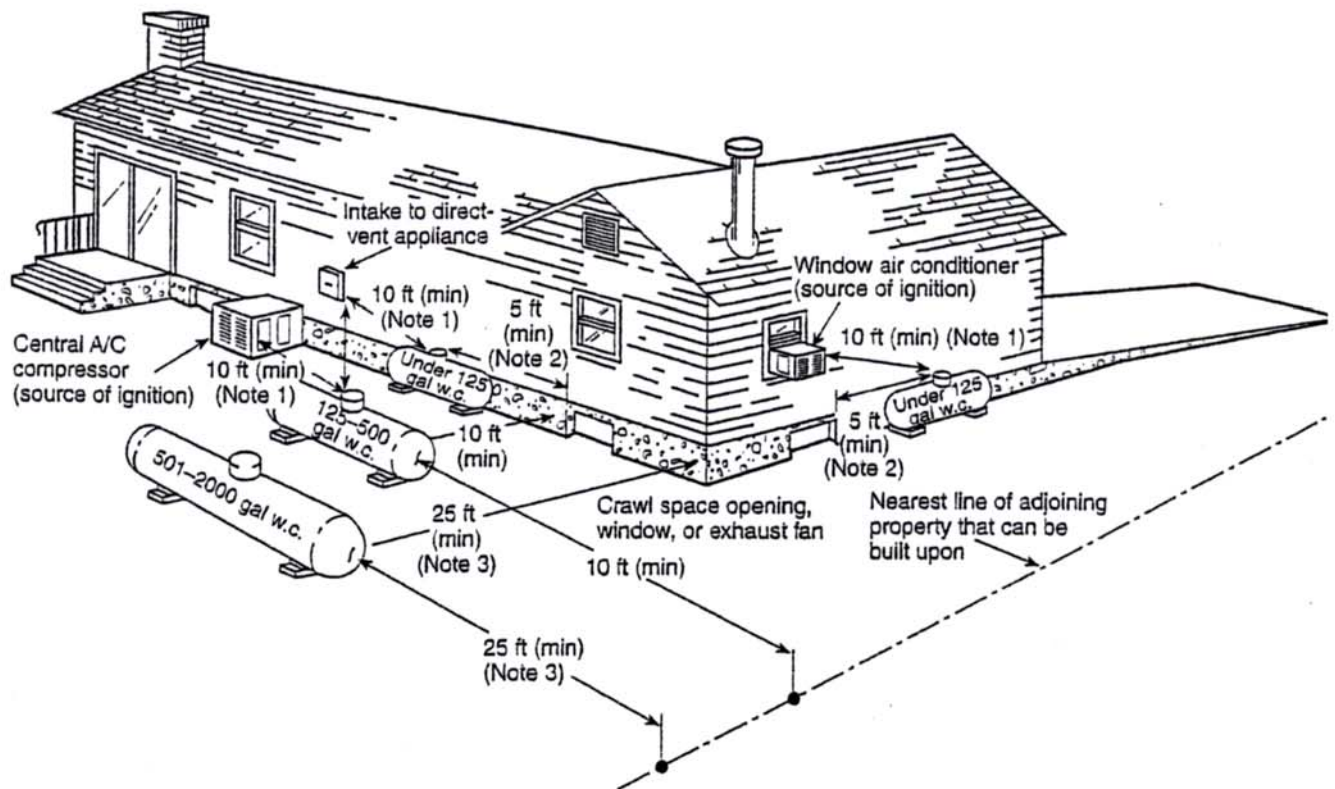

Note 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliance, or intake to a mechanical ventilation system. Refer to 6.3.9.

Note 2: Refer to 6.3.9.

Note 3: This distance may be reduced to no less than 10 ft for a single container of 1200 gal (4.5 m<sup>3</sup>) water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gal (0.5 m<sup>3</sup>) water capacity. Refer to 6.3.3.