


# TC Figure 16 Underground LPG Tank

2.25.21

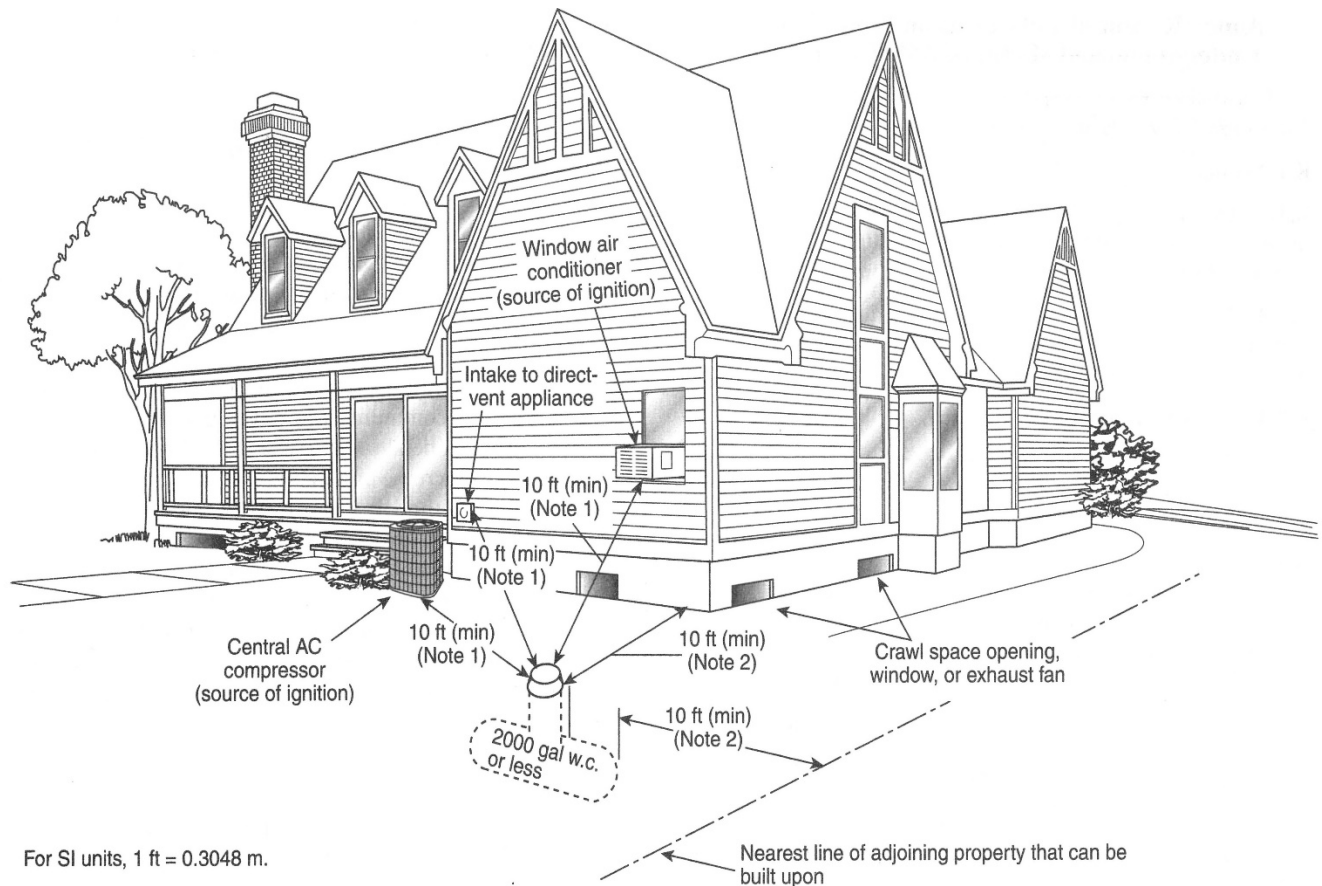

For SI units, 1 ft = 0.3048 m.

**Notes:**

- (1) The relief valve, filling connection, and fixed maximum liquid level gauge vent connection at the container must be at least 10 ft from any exterior source of ignition, openings into direct-vent appliances, or mechanical ventilation air intakes. Refer to 6.3.4.4.
- (2) No part of an underground container can be less than 10 ft from an important building or line of adjoining property that can be built upon. Refer to 6.3.2.3.

**FIGURE I.1(c) Underground ASME Containers.** *(Figure for illustrative purposes only; code compliance required.)*