




# TC Figure 15 Liquid Propane Setbacks

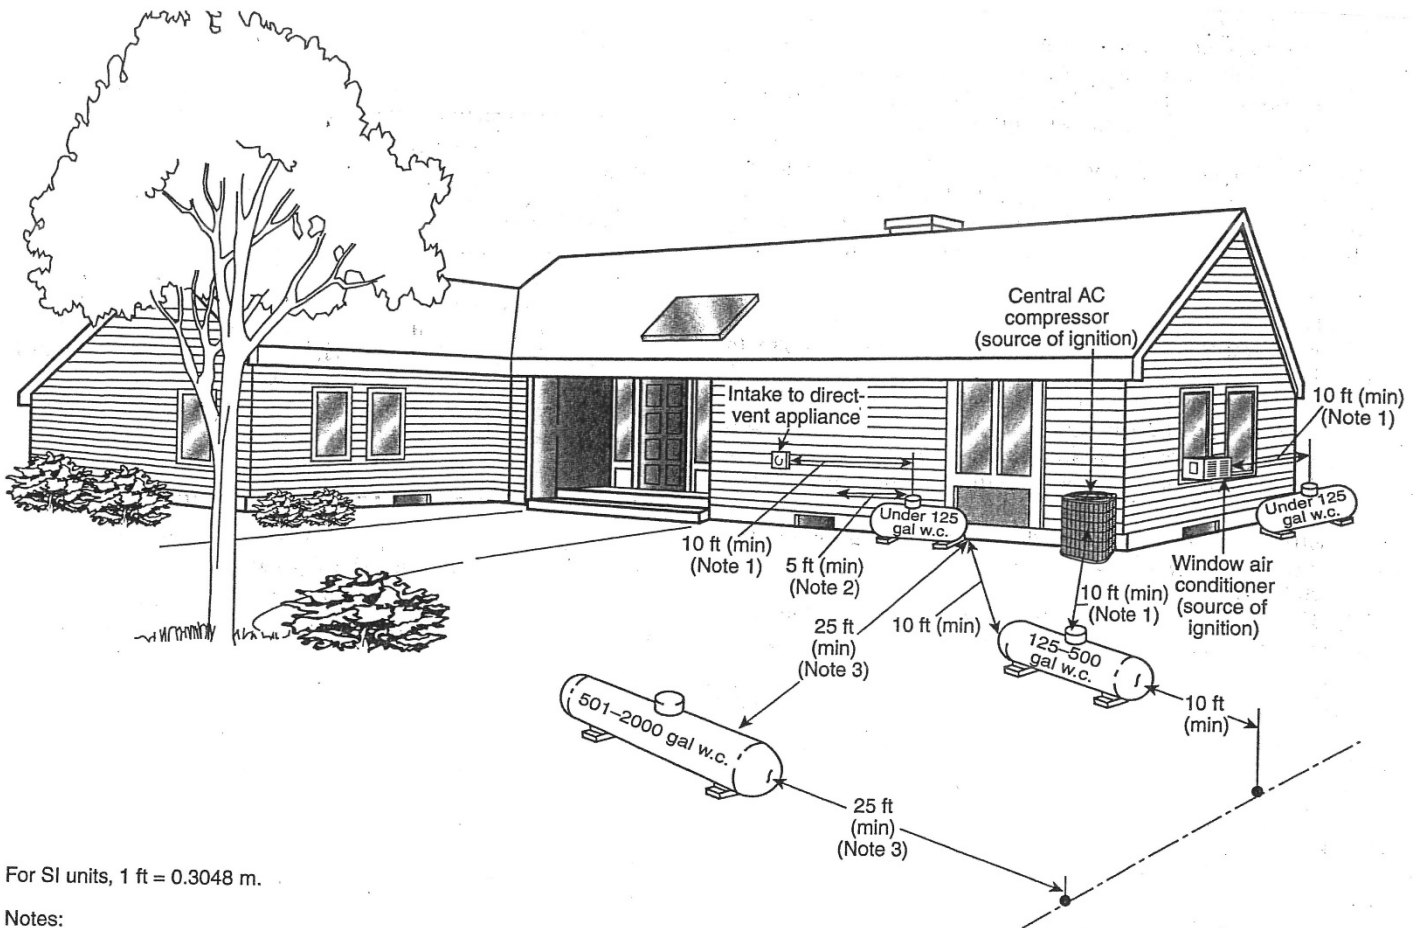

For SI units, 1 ft = 0.3048 m.

**Notes:**

- (1) Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window AC, compressor), intake to direct-vented gas appliance, or intake to a mechanical ventilation system. Refer to 6.3.4.4.
- (2) Refer to 6.3.4.3.
- (3) This distance can be reduced to no less than 10 ft for a single container of 1200 gal (4.5 m<sup>3</sup>) water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gal (0.5 m<sup>3</sup>) water capacity. Refer to 6.3.1.3.

**Thurston County Building Development Center**

2000 Lakeridge Drive SW, Bldg 1, Second Floor; Olympia, WA 98502 Phone: (360) 786-5490; TYY/TDD Line: 711 or 1-800-833-6388; Fax: (360) 754-2939

[www.thurstoncountybdc.com](http://www.thurstoncountybdc.com)